



GERAND ENGINEERING

"MODEL G" FIRE PUMP TEST METERS

Accurate Pump Performance and Quality Service for 50 Years

MODEL-G METERS

-- RATING 500 PSI --
(Buttweld, Grooved,
300# Flanged)

-- RATING 275 PSI --
(150# Flanged)

CALIBRATED VENTURI &
ATTACHED GPM METER

4½" DIAL METER
MOUNTS ON
VENTURI BRACKET



ADDITIONAL SIZES LISTED
AT WWW.GERAND.COM

PUMP GPM	PIPE SIZE	VENTURI STYLE	METER RANGE (GPM)	VENTURI LENGTH (BUTTWELD OR GROOVED)	VENTURI LENGTH (150# FLANGED)	VENTURI LENGTH (300# FLANGED)
50	2"	685	25-100	4¼" THREADED	--	--
100	2 1/2"	746	50-200	3" BUTTWELD 4" GROOVED	9½"	10"
250	4"	744	125-500	3½" BUTTWELD 3¼" GROOVED	9½"	10¾"
300	4"	744	150-600			
450	4"	744	225-900	5"	12"	13¼"
500	5"	715	250-1000			
500	6"	743	250-1000			
750	6"	743	375-1500	6"	13"	14¼"
1000	6"	743	500-2000			
1250	6"	743	625-2500			
1500	8"	750	750-3000	7"	15"	16¼"
2000	8"	750	1000-4000			
2500	8"	750	1250-5000			

WWW.GERAND.COM FOR MORE INFORMATION

*Venturi available in Raised or Flat Face; Steel, Stainless Steel or Monel
**Dual LPM/GPM Scales Available



**BEST VALUE
IN THE
INDUSTRY**

**5 YEAR
WARRANTY**


**MANUFACTURED
IN THE USA**

**HIGH GRADE
MATERIALS:
CARBON STEEL,
STAINLESS STEEL,
EPOXY AND
MONEL**




VENTURI STYLES


BUTTWELD

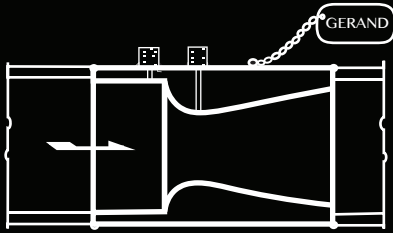


GROOVED

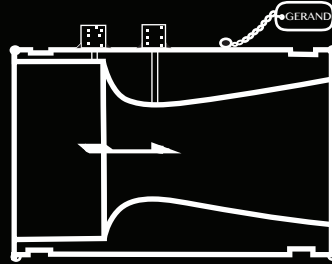

FLANGED

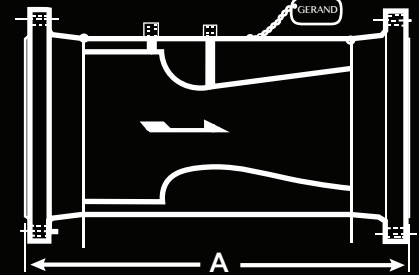

OPERATING INSTRUCTIONS

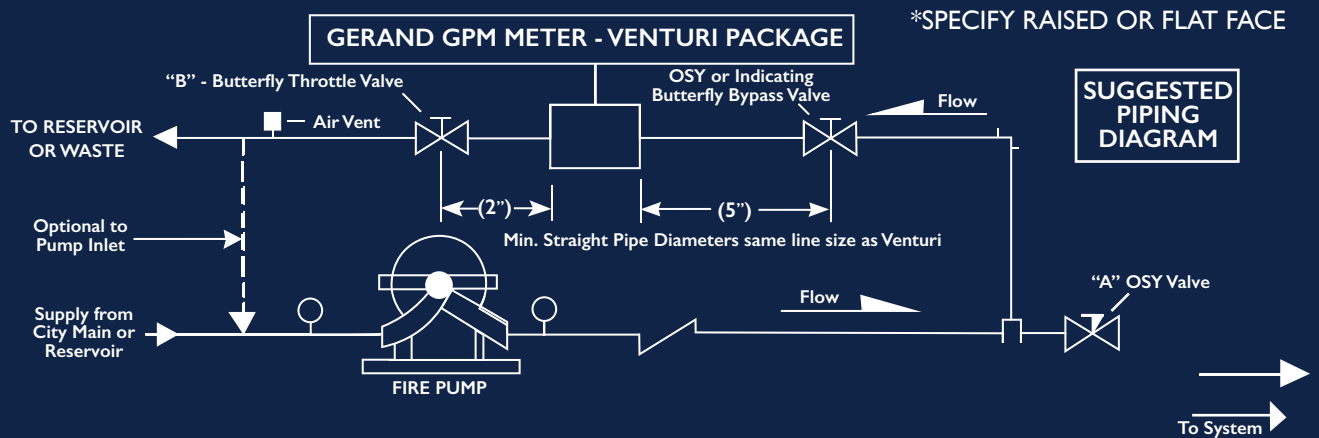

1. Close system OSY valve "A"
2. Open by-pass valve and "B" butterfly throttle valve
3. Purge meter, located on venturi, as follows:
 - a) Open station shut-off valves on venturi & vent valves attached to meter. When a steady stream of water passes through hose, meter is purged of air.
 - b) Close the vent valves after purging.
4. Start the fire pump, and read meter in GPM.
5. Refer to pump GPM requirement and adjust throttle valve to meet the requirement.
6. After the test, open valve "A" and close the by-pass and "B" valves.

